

BS EN 1192:2000



Test of: 44mm single door set

Doors – Classification of strength requirements

A Report To:
Morland
Buttington Cross Ent Park, Welshpool, Powys. SY21 8SL

Document Reference:
WIL 415946

Date: 10/09/2019

Copy: 1

Issue No.: 1

Page 1

TEST CONCLUSIONS

Samples of:
Manufacturer Morland
Product Single doorset
Model 44mm single doorset

have been tested in accordance with: BS EN 1192:2000.
By Element Materials Technology, a UKAS accredited Testing Laboratory (No. 0621)

At Unit 3 Wednesbury One, Black Country New Road, Wednesbury, WS10 7NZ.
Results and comments as detailed below:

Clause	Description	Compliance
4.1	General – Class 4- SEVERE Duty	Yes
4.2	Resistance to vertical load	YES
4.3	Resistance to static torsion	YES
4.4	Resistance to soft and heavy body impact	YES
4.5	Resistance to hard body impact	YES

No inferences can be made regarding performance against other requirements of this standard

Tests marked “ N/A ” are not applicable to the sample under test.
Tests marked “N/T” were not applied to the sample under test

AUTHORISATION

Tests performed by: Josh Ratcliffe, Test Engineer

Report issued by: Chris Bryan, Senior Test Engineer



Signed

Date 10th September 2019

For and on behalf of Element Materials Technology

Report authorised by: Mark West, Door & Window Laboratory Manager



Signed

Date 10th September 2019

For and on behalf of Element Materials Technology

Report issued: 10 September 2019



NOTE.

Tests marked "Not UKAS Accredited" are not covered by the Laboratory UKAS accreditation schedule.

Tests marked NT were not tested

Tests marked NA are not applicable to the product on test.

The laboratory has tested the product supplied by the client as sampled in accordance with their own requirements

This report shall not be reproduced except in full, (and then only as permitted by copyright laws), without written approval from Element Materials Technology. All work and services carried out by Element Materials Technology Wednesbury Ltd are subject to, and conducted in accordance with, the Standard Terms and Conditions of Element Materials Technology Wednesbury Ltd, which are available at <https://www.element.com/terms/terms-and-conditions> or upon request.



CONTENTS

PAGE NO.

TEST CONCLUSIONS..... 2
AUTHORISATION..... 3
TEST DETAILS 5
TEST PROCEDURE 6
INITIAL OBSERVATIONS..... 7
TEST SPECIMEN 10
SCHEDULE OF COMPONENTS..... 11
PERFORMANCE CRITERIA & TEST RESULTS..... 14
CONCLUSIONS 16
LIMITATIONS 16
REVISION HISTORY 17

TEST DETAILS

CLIENT DETAILS

Company name Morland
Address Buttington Cros Ent Park
Welshpool
Powys
SY21 8SL

Contact Mike Bebb

ORDER DETAILS

Order number MP0577
Dated 19/06/2019

SAMPLE DETAILS

Outer frame 990 x 2081 x 100mm
Opening leaves 924 x 2040 x 44mm
Configuration Single doorset
Material Timber
Details of Hardware
Hinges 3No. Zoo Ball bearing hinges. Ref: ZHSS243RS
Lock Zoo 72mm sash 52mm backset. Ref: ZDL005RSS
Handles Zoo Levers on Rose 19mm DIA 304 Grade SSS. Ref: ZCS030SSS

TEST DETAILS

Test specification BS EN 1192 :2000
Full test Yes
Test to clauses All
Test methods BS EN 12046-2:2000 operating forces
BS EN 947:1999 vertical load
BS EN 948:1999 static torsion
BS EN 949:1999 soft body impact
BS EN 950:1999 hard body impact

Sample received 27/06/2019
Test started 01/07/2019
Test completed 01/07/2019

Special Test requirements None
Other reports to be used in conjunction with this report None

TEST PROCEDURE

Introduction	<p>This test report should be read in conjunction with the Standard BS EN 1192:2000.</p> <p>The specimens were judged on their ability to comply with the performance criteria as required in BS EN 1192:2000, with test methods BS EN 12046-2:2000, BS EN 947:1999, BS EN 948:1999, BS EN 949:1999, BS EN 950:1999 classified in accordance with BS EN 1191:2000.</p>
Instruction To Test	<p>Initial requirement was for a class 4 as defined in BS EN 1192:2000.</p>
Test Specimen Construction	<p>A description of the test construction is given in the Schedule of Components. The description is based on a detailed survey of the specimens and information supplied by the sponsor of the test.</p>
Installation	<p>The doorset was supplied mounted within a timber sub-frame of nominal section 75 x 100mm fitted flush with the exterior face, in accordance with the clients fitting instructions.</p>
Sampling	<p>The samples were not independently witnessed or selected and were provided direct from the test sponsor.</p>
Test Climate	<p>The sample was conditioned in the laboratory in the range 15-30 °C and 25-75% humidity.</p> <p>The temperature and humidity in the lab was maintained in the range 24-25.3°C and 40.4-61% humidity for the duration of the test.</p>

INITIAL OBSERVATIONS

**The internal face
of the sample**








TEST SPECIMEN

Figure 1- General Elevation of Test Specimen (External Face)

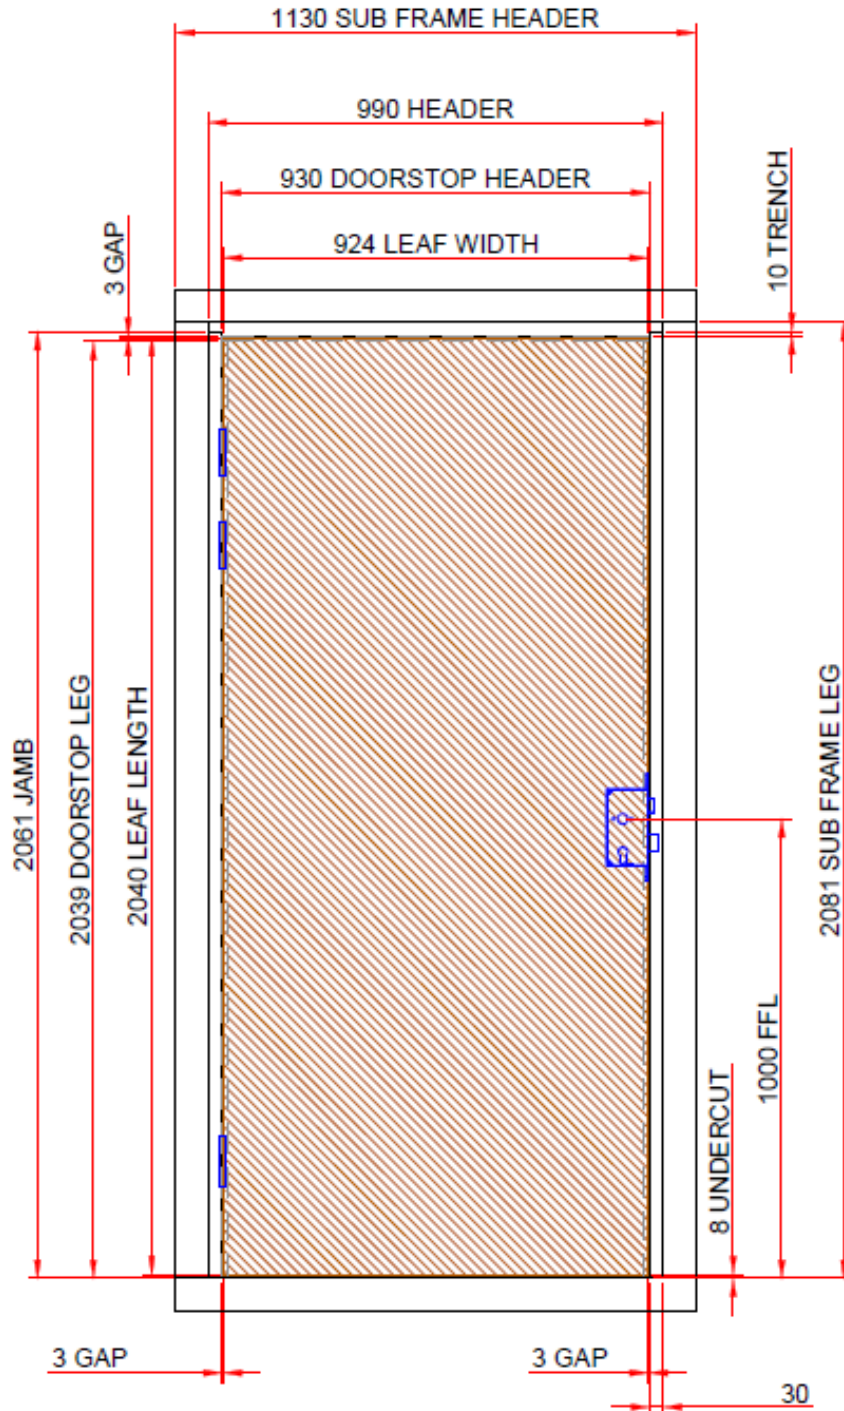

Do not scale. All dimensions are in mm

SCHEDULE OF COMPONENTS

(Refer to Figures 1 to 3)
(All values are nominal unless stated otherwise)
(All other details are as stated by the sponsor)

Variants

None

Item

Description

1. Door frame head

Reference	:	Plant on
Material	:	MR MDF
Density	:	680kg/m ³ (stated)
Section size	:	30mm thick
Rebate	:	32 x 12mm MR MDF doorstop
Fixing jamb to head joints		
i. type	:	Confirmat screws
ii. size	:	5 x 50mm
iii. quantity	:	4No.
Details of adhesive	:	PVA Glue

2. Door frame jamb

Reference	:	Plant on
Material	:	MR MDF
Density	:	680kg/m ³ (stated)
Section size	:	30mm thick
Rebate	:	32 x 12mm MR MDF doorstop

3. Door frame weather seals

Description	:	Exitex Twin Flipper
Manufacturer	:	Exitex
Reference	:	1.10.0500
Fixing method	:	Self-adhesive
Position	:	Jamb & header
Continuity	:	Uninterrupted by hardware

4. Door leaf

Supplier/manufacturer	:	Morland / Egger
Overall leaf size	:	2040 x 924 x 44mm

5. Door leaf core

Supplier/manufacturer	:	Egger
Material	:	Cellulosic material
Density	:	540kg/m ³ (stated)
Thickness	:	44 / 54mm

6. Door leaf lippings

Document No.:	WIL 415946	Page No.:	11 of 17
Author:	C Bryan	Issue Date:	10/09/2019
Client:	Morland	Issue No.:	1

Item

Description

Position : Fitted to all four edges
 Material : ABS
 Density : 1150kg/m3 (stated)
 Details of adhesive : Pur

7. Hinges

Supplier/manufacture : Zoo
 Description : Ball bearing
 Reference : ZHSS243RS
 Primary material : S. Steel grade
 Size of knuckle : 14mm
 Size of blades : 100 x 30mm
 Quantity : 3No.
 Intumescent protection (if applicable) : 0.8mm graphite
 Position of hinges
 i. top hinge : 200mm from top of door to top of hinge
 ii. middle hinge : 400mm from top of door to top of hinge
 iii. bottom hinge : 1738mm from top of door to top of hinge
 Fixing hinge to doorleaf
 i. type : Stainless steel screw
 ii. size : 2No. 5 x 30mm screws & 2No. 5 x 60mm screws
 iii. quantity : 4No.
 Fixing hinge to frame
 i. type : Stainless steel screw
 ii. size : 5 x 25mm
 iii. quantity : 4No.

8. Lock

Supplier/manufacture : Zoo
 Description : 72mm sash 52mm backset
 Reference : ZDL005RSS
 Face plate size : 20 x 230mm
 Position : 1000mm FFL
 Fixings
 i. type : Screw
 ii. size : 3 x 20mm
 iii. quantity : 2No.

9. Lock Keeps

Document No.: WIL 415946
 Author: C Bryan
 Client: Morland

Page No.: 12 of 17
 Issue Date: 10/09/2019
 Issue No.: 1

Item

Description

Supplier/manufacturer : Zoo
 Description : Locking keep
 Reference : ZUKS364SS
 Material : Stainless steel
 Fixing keeps to frame
 i. type : Screw
 ii. size : 3 x 20mm
 iii. quantity : 3No.

10. Lever handles

Supplier/manufacturer : Zoo
 Description : Levers on Rose 19mm DIA 304 Grade SSS
 Reference : ZCS030SSS
 Material : 304 GRADE SSS
 Lever length : 125mm
 Fixings
 i. type :
 ii. size : 2No. 8mm Bolt through fixings 4No. Screws to face of door
 iii. quantity : 6No.

11. Door closer

Supplier/manufacturer : Briton
 Description : Arm closer
 Reference : 11208
 Overall size : 236 x 38 x 60mm
 Fixing device to doorleaf
 i. type : Stainless steel screws
 ii. size : 4 x 25mm
 iii. quantity : 4No.
 Fixing device to frame
 i. type : Stainless steel screws
 ii. size : 4 x 50mm
 iii. quantity : 2No.

PERFORMANCE CRITERIA & TEST RESULTS

Clause	Result	Pass/Fail
BS6375-2 6.2 Operating forces	<p>The average force required to enable the sample to latch must not exceed those defined in table 1 of BS EN 12217, Class 1 (75N) for external doorsets & class 2 (50N) for internal doorsets. The average force or torque required to operate the hardware must not exceed those defined for the relevant class in table 1 on BS EN 12217, Class 1 (100N or 10Nm) for external doorsets & class 2 (50N or 5Nm) for internal doorsets). The average force required to commence and maintain motion must not exceed those defined for the relevant class in table 1 on BS EN 12217, Class 1 (75N) for external doorsets & Class 2 (50N) for internal doorsets</p> <p>The sample met the requirements of Class 2.</p> <p>An average force of 10.83N was required to latch the sample. An average force of 29.5N was required to disengage the hardware. An average force of 11N was required to commence and maintain motion.</p>	PASS CLASS 2
Clause 4.2 Resistance to vertical load	<p>The doorset was tested in accordance with EN 947, under a load of 1000N as required by Class 4 of EN 1192, with a preload of 200N. To achieve the requirements of the class the resultant residual deformation should not exceed 1mm, and the specimen should continue to operate normally.</p> <p>A load of 1000N was applied, and the doorset continued to operate normally.</p> <p>The sample met the requirements of Class 4. The deflection under full load was 2.95mm, and the residual deflection was 0.2mm.</p>	PASS CLASS 4
Clause 4.3 resistance to static torsion	<p>The doorset was tested in accordance with EN 948, under a load of 350N as required by Class 4 of EN 1192, with a preload of 200N. To achieve the requirements of the class the resultant residual deformation should not exceed 2mm, and the specimen should continue to operate normally.</p> <p>A load of 350N was applied, and the doorset continued to operate normally.</p> <p>The sample met the requirements of Class 4. The deflection under full load was 12.34mm, and the residual deflection was 1.23mm.</p>	PASS CLASS 4
Clause 4.4 Resistance to soft and heavy body impact	<p>The doorset was tested in accordance with EN 949, a soft & heavy body impact of 180J was applied as required for class 4. To achieve the requirements of the class the resultant residual deformation in flatness should not exceed 2mm, and the specimen shall continue to operate normally..</p>	PASS CLASS 4

Clause	Result	Pass/Fail
	<p>The sample met the requirements of class 4, with a residual deformation of 0mm on the internal face, and a residual deformation of 0mm on the external face.</p> <p>No damage was observed during the test</p>	
<p>Clause 4.5 Resistance to hard body impact</p>	<p>The doorleaf was tested in accordance with EN 950, hard body impacts of 3J were applied as required for class 2.</p> <p>To achieve the requirements of the class the mean value of the diameters of indentation should not exceed 20mm, and the mean values of the depths of indentation should not exceed 1.0mm, with the maximum depth not exceeding 1.5mm.</p> <p>The sample met the requirements of class 2. The mean value of the depth of indentation was 0.09mm. The maximum value of the depth of indentation was 0.13mm. The mean value of the diameter of indentation was 8.07mm. No damage was observed during the test.</p>	<p>PASS CLASS 4</p>

CONCLUSIONS

Evaluation against objective

The sample as provided by the client was subjected to operational & strength testing in accordance with BS EN 1192:2000 and achieved the requirements of Class 4.

Observations & comments

LIMITATIONS

Limitations

The results relate only to the behaviour of the specimens of the element of construction under the particular conditions of test. They are not intended to be the sole criteria for assessing the potential performance of the element in use, nor do they reflect the actual behaviour in use.

Range of door assemblies covered by this report

It is our opinion that the range of door assemblies covered by this report are limited to the following

- Assemblies with identical hardware fitted no further apart than in the tested assembly
- Assemblies of the same or smaller overall dimensions to the tested assembly

Uncertainty of Measurement

The uncertainties of measurements calculated for a confidence level of 95% throughout these tests are within the limits of these tolerances.

The standard specifies the following tolerances

- Forces: $\pm 2\%$
 - Distances: $\pm 1\text{mm}$ for tape measures $\pm 0.01\text{mm}$ for dial gauges
 - Times: $\pm 5\text{s}$
-

REVISION HISTORY

This issue of the report replaces all previous issues that are now withdrawn.

Issue No :	Re - Issue Date :
Revised By:	Approved By:
Reason for Revision:	

END OF REPORT